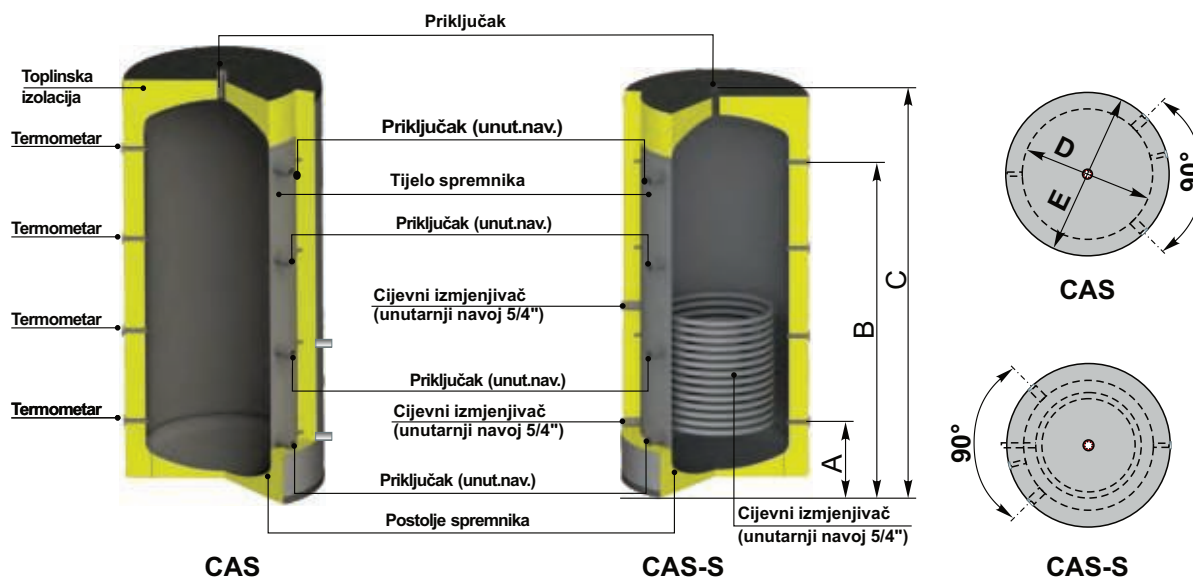
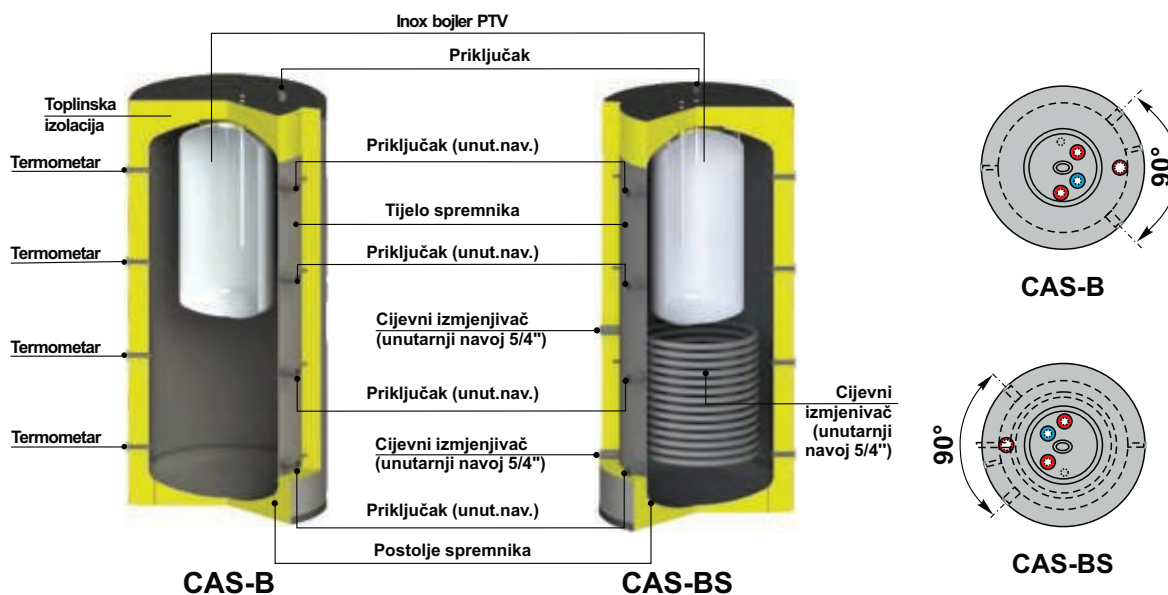


PRESJECI SPREMNIKA

PRESJECI SPREMNIKA


Tip	CAS								CAS-S			CAS-BS			CAS-B		
	501	801	1001	1501	2001	3001	4001	5001	501	801	1001	501	801	1001	501	801	1001
Volumen (lit.)	475	740	940	1450	2160	2960	3820	5055	475	740	940	475	740	940	475	740	940
Promjer tijela sprem. D (mm)	650	790	790	1000	1200	1250	1400	1600	650	790	790	650	790	790	650	790	790
Vanjski promjer E (mm)	850	990	990	1200	1400	1450	1600	1800	850	990	990	850	990	990	850	990	990
Ukupna visina C (mm)	1715	1795	2195	2145	2225	2740	2835	2920	1715	1795	2195	1715	1795	2195	1715	1795	2195
Priključci (R)	6/4"	6/4"	6/4"	6/4"	6/4"	2"	2"	2 1/2"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"	6/4"
Max. radni tlak (bar)	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3
Max. radna temp. (°C)	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Min. visina prostorije (mm)	1915	1995	2395	2345	2380	2960	3060	3050	1915	1995	2395	1915	1995	2395	1915	1995	2395
Masa tijela spremnika (kg)	75	99	149	185	245				100	135	185	120	175	225	105	135	176
Ukupna masa spremnika (kg)	84	112	164	204	265				109	150	201	129	190	241	114	150	191
Volumen sprem. PTV (lit.)	-	-	-	-	-	-	-	-	-	-	-	125	170	170	125	170	170
Max. radni tlak spr. PTV (bar)	-	-	-	-	-	-	-	-	-	-	-	6	6	6	6	6	6
Priključci PTV (R)	-	-	-	-	-	-	-	-	-	-	-	3/4"	3/4"	3/4"	3/4"	3/4"	3/4"
Ogrj. površina spirale (m ²)	-	-	-	-	-	-	-	-	1,9	2,6	3,2	1,9	2,6	3,2	-	-	-
Volumen ogrj. spirale (lit.)	-	-	-	-	-	-	-	-	10,5	14	17,5	10,5	14	17,5	-	-	-
Toplinska izolacija (mm)	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100
Visina A (mm)	230	320	320	320	355	370	420	515	230	320	320	230	320	320	230	320	320
Visina B (mm)	1380	1370	1770	1720	1755	2260	2310	2365	1380	1370	1770	1380	1370	1770	1380	1370	1770